



SUPPLEMENTAL/ BID BULLETIN
SBB2021-004

For the Project:

PROCUREMENT OF CLASS "B" WATER METERS REQUIREMENT OF SMWD FOR CY 2021
Reference No. PB2021-SMWD-G-005

In accordance with Section 22.5.2 of IRR of RA No. 9184, the SMWD-BAC is issuing this Supplemental/Bid Bulletin to make an addendum and clarifications to the bidding documents and technical specifications of the above stated project.

CLARIFICATIONS AND ADDENDUM:

1. **For Technical Specifications – Body – Material Brass Cu. 58%**
The bidder shall attach test result for brass content. Testing Center should be accredited by DOST.
2. The bidders shall bring samples of water meter, one pc. each for the required sizes together with the bidding documents:

Water meter ½" - 1 sample

Water meter ¾" - 1 sample

Water meter 1" - 1 sample

Samples will be subjected to calibration testing of SMWD

3. The logo of the SMWD in water meters shall be colored, laser print, and the color is blue.
4. **SHOP DRAWING PERFORMANCE AND DIMENSION.** Each water meter should include two (2) tailpieces and rubber gaskets. The tailpiece shall be brass and conforming to the following dimension:

FROM:

	Unit	DN15 (1/2")	DN20 (3/4")	DN25 (1")
Length	mm	55	60	70

TO:


	Unit	DN15 (1/2")	DN20 (3/4")	DN25 (1")
Length	mm	45	50	58

SPECIAL CONDITIONS OF CONTRACT:


FROM: 5.1	The period for correction of defects in the warranty period is within ninety (90) days upon receipt of the items to be replaced.
TO: 5.1	The period for correction of defects in the warranty period is within ninety (90) days upon receipt of the items to be replaced. If the supplier failed to replace the items (water meter) the Procuring Entity will be charged/billed the total amount to the supplier, the amount of replacement shall be the amount of the water meter as bought.

This SUPPLEMENTAL/BID BULLETIN, was issued this 6th day of March 2021 to clarify the area of extraction of the project and such clarification shall be an integral part of the bidding documents.

For information and guidance of all concerned.


MARIA LEONORA S. ROMARATE
Chairperson-SMWD Bids and Awards Committee

Visualization

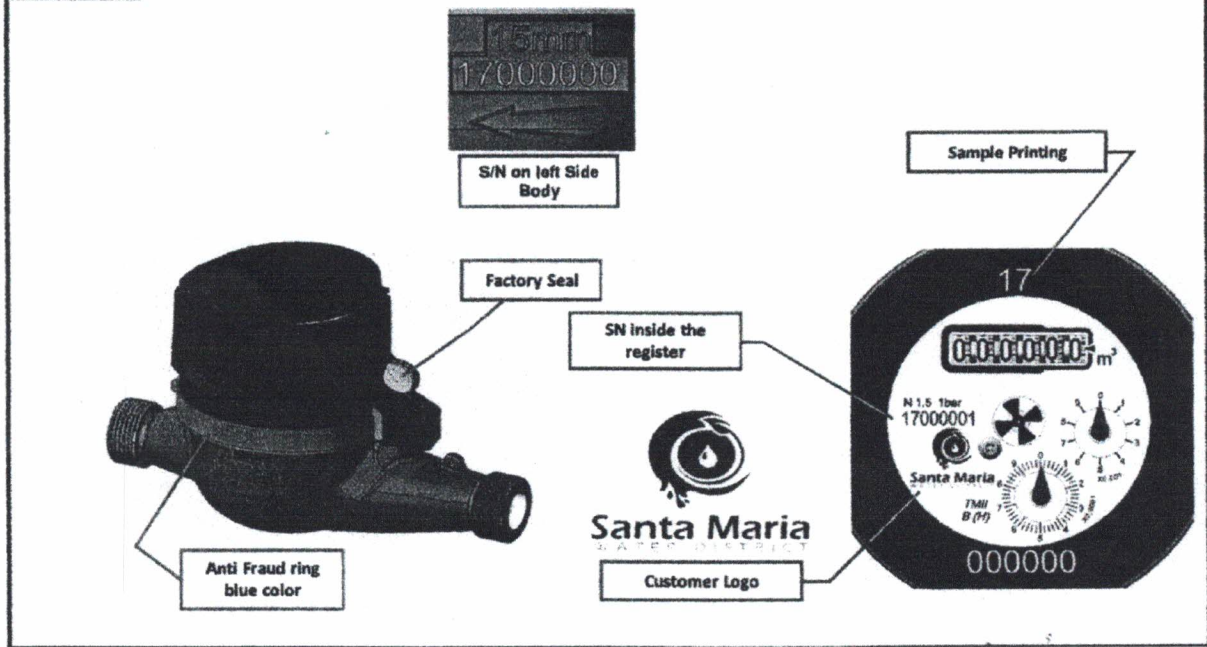

1. The logo of the SMWD in the water meter shall be colored laser print, specifically the color is blue.

Jeonora f. marate



Santa Maria

WATER DISTRICT

Jonathan Bonar