

October 6, 2023

P-RFQ No. 2023-075

REQUEST FOR QUOTATION

SUPPLY AND DELIVERY OF BNG FOR CAST IRON (CI) FITTING AND VARIOUS DUCTILE IRON (DI) FITTINGS

The Santa Maria Water District (SMWD) hereinafter referred to as “the Purchaser”, through its Bids and Awards Committee (BAC), invite interested parties to submit price quotation for the project, “**SUPPLY AND DELIVERY OF BNG FOR CAST IRON (CI) FITTING AND VARIOUS DUCTILE IRON (DI) FITTINGS**” through Small Value Procurement (Sec. 53.9 of R.A. No. 9184) with Approved Budget for the Contract (ABC) of Two Hundred Seventy-Eight Thousand Eight Hundred Ninety-One and Fifteen Centavos Only (**₱278,891.15**).

	Description	Qty	Unit	Unit Cost	Total Amount
1	BNG FOR CI FITTING 100mm (AWWA)	3	SET		
2	DI ADAPTOR RF 150mm with BNG	15	PC		
3	DI SLEEVE TYPE COUPLING TR 150mm	20	PC		
	*** nothing follows ***				
	Please see attached technical specifications				

All items listed under the purchaser’s specifications must be complied on a pass-fail basis.

Failure to meet any one of the requirements will result to rejection.

Likewise, it is understood that Purchaser’s specifications are minimum requirements. The Bidder/Supplier may offer higher specifications or additional items, if any.

Procurement procedures will be conducted in accordance with the provisions of the Implementing Rules and Regulations (IRR) of Republic Act No. 9184 (Government Procurement Reform Act).

It is the intent of the Purchaser to evaluate the quotation for the item and award will be made to the quotation resulting in the overall lowest cost, meeting purchaser’s technical specifications.

Likewise, in accordance with Section 54.6 and Appendix A of Annex "H" (Consolidated Guidelines for the Alternative Methods of Procurement) of the IRR of RA No. 9184, the supplier shall provide the following documentary requirements as a **condition for award** of the contract. The documents shall be attached together with the quotations.

1. PhilGEPS Registration Number



2. Mayor's/Business Permit
3. Photo Copy of Sample Official Receipt (OR)
4. Certificate of Registration (BIR FORM 2303); and
5. Duly Notarized Omnibus Sworn Statement. (If unable to have the document notarized, you may submit a signed unnotarized Omnibus Sworn Statement, subject to compliance therewith after award of contract but before payment).

Your prices must be quoted in Philippine Peso and must include the unit price and total price, inclusive of all taxes to be paid and other incidental cost to the delivery site if the contract is awarded.

Payment shall be through check and advance payment is not allowed. Payment shall only be made upon completion of delivery of all items.

All quotations may be typewritten or handwritten and may be placed in sealed envelope marked "**SUPPLY AND DELIVERY OF BNG FOR CAST IRON (CI) FITTING AND VARIOUS DUCTILE IRON (DI) FITTINGS**" (RFQ No. 2023-075) and must be submitted on or before **October 11, 2023, 11:00AM** at the SMWD main office. It may also be sent thru email on our official email address at smwdbulacan@yahoo.com on the specified time stated above and address to the General Manager, Engr. Carlos N. Santos Jr.

Quotations shall be valid for thirty (30) calendar days from the deadline of submission of the same.

The delivery period shall be within **5 Days** from receipt of the Purchase Order (PO). The supplier should inform the purchaser at least two (2) days before the date of delivery. The Purchaser shall have the right to reject or to return the items that will be declared defective. The delivery will be made only during working days from 8:00 AM to 5:00 PM.

DELIVERY SITE: General Services Division of SMWD located at 301 J. P. Rizal St., Dulong Bayan, Santa Maria, Bulacan.

The prospective supplier shall submit the following:

- a) Duly accomplished Quotation Form; and
- b) Brochures of the items offered, if any.

The Santa Maria Water District reserves the right to accept or reject any quotation, and to annul the procurement process and reject all quotations at any time prior to Contract award, without thereby incurring any liability to the affected supplier or suppliers. SMWD also reserves the right to waive any required formality in the proposals received, and select the proposal which it determines to be the most advantageous to the government.

Prepared by:



Sgd.

Romel P. Lazaga
Procurement Assistant

Noted by:

Sgd.

Maria Leonora S. Romarate
BAC Chairperson

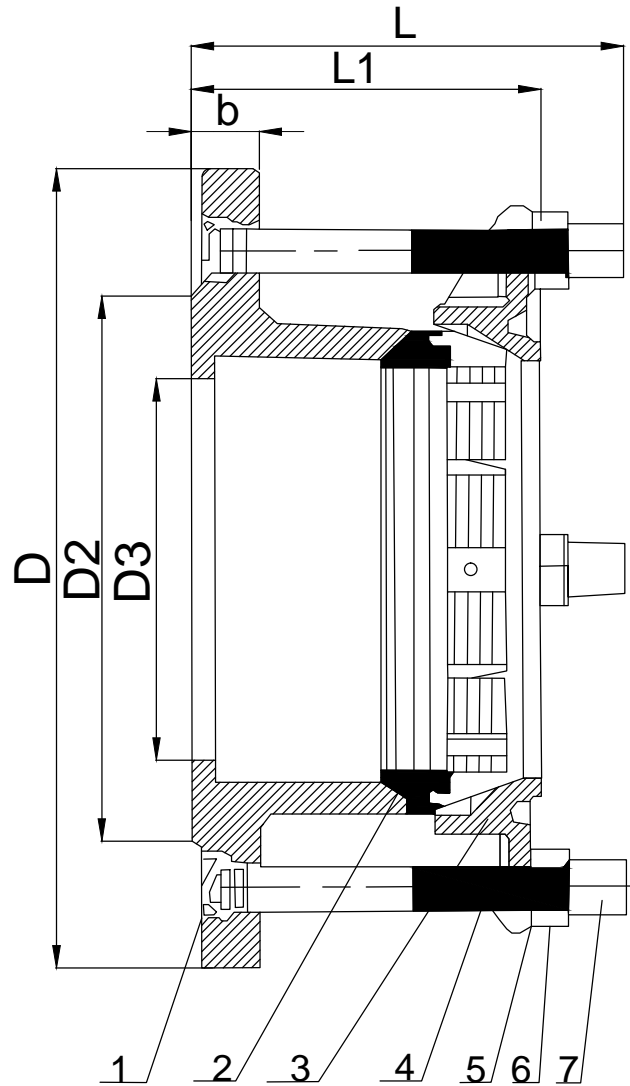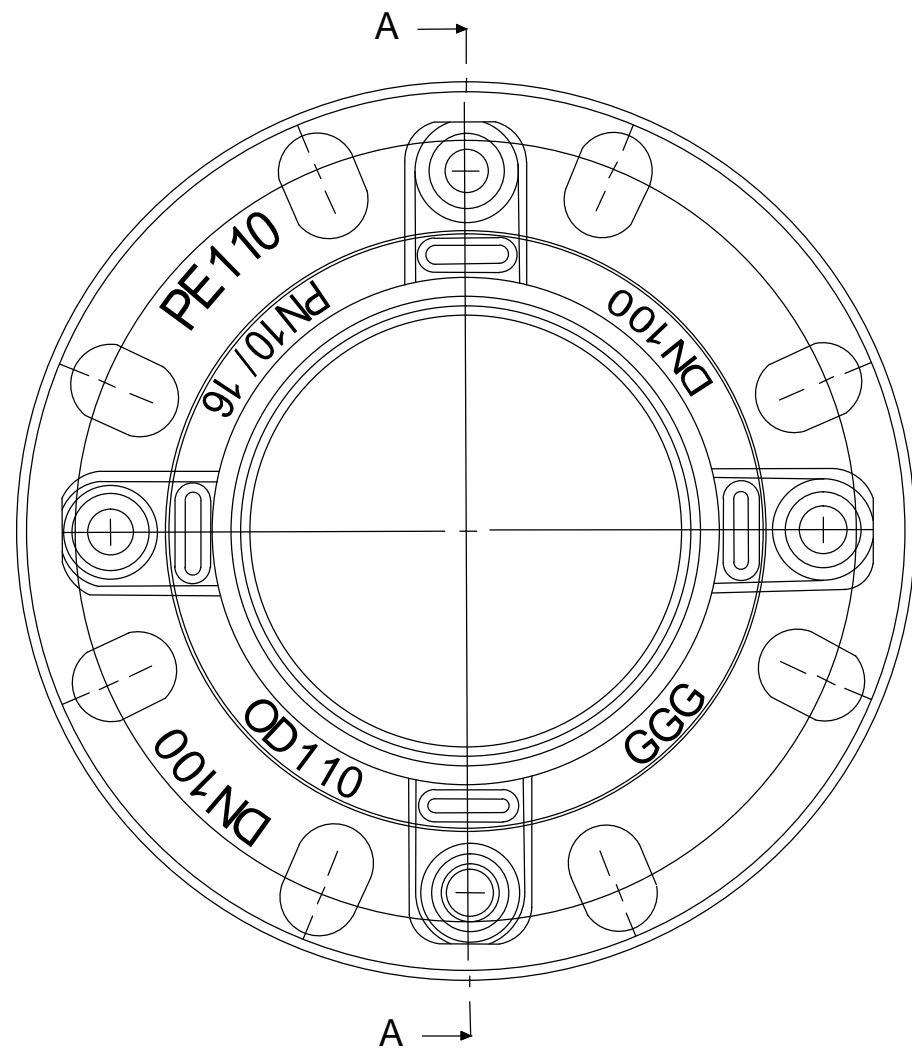

No.	PartsName
1	Body
2	TensileSealingRing
3	Bracket
4	Washer
5	Nut
6	SquareNeckBolt
7	Cap

TABLE OF DIMENSION IN MILLIMETER						
SIZE	Pipe OD	D3	D	b	L	L1
DN50	50	50	165	18	63	125
DN50DN60DN65	63	55	180	18	63	125
DN60DN65	75	66	180	18	63	125
DN80	90	84	180	18	63	125
DN100	110	105	200	18	63	125
DN125	125	125	220	18	63	125
DN150	160	154	285	18	63	125
DN200	200	200	340	18	63	125
DN200	225	210	340	23	82	175
DN250	250	250	400	26	82	175
DN250	280	275	400	26	88	175
DN300	315	302	455	26	88	175

STANDARD SHOP DRAWING

STA. MARIA WATER DISTRICT

SHEET NO.

D.I. Restrained Flange Adaptor


Prepared By:

Engr. Emmanuel Enrico A. de Vera
Department Manager B

Approved By:

Engr. Carlos N. Santos, Jr.
General Manager

5

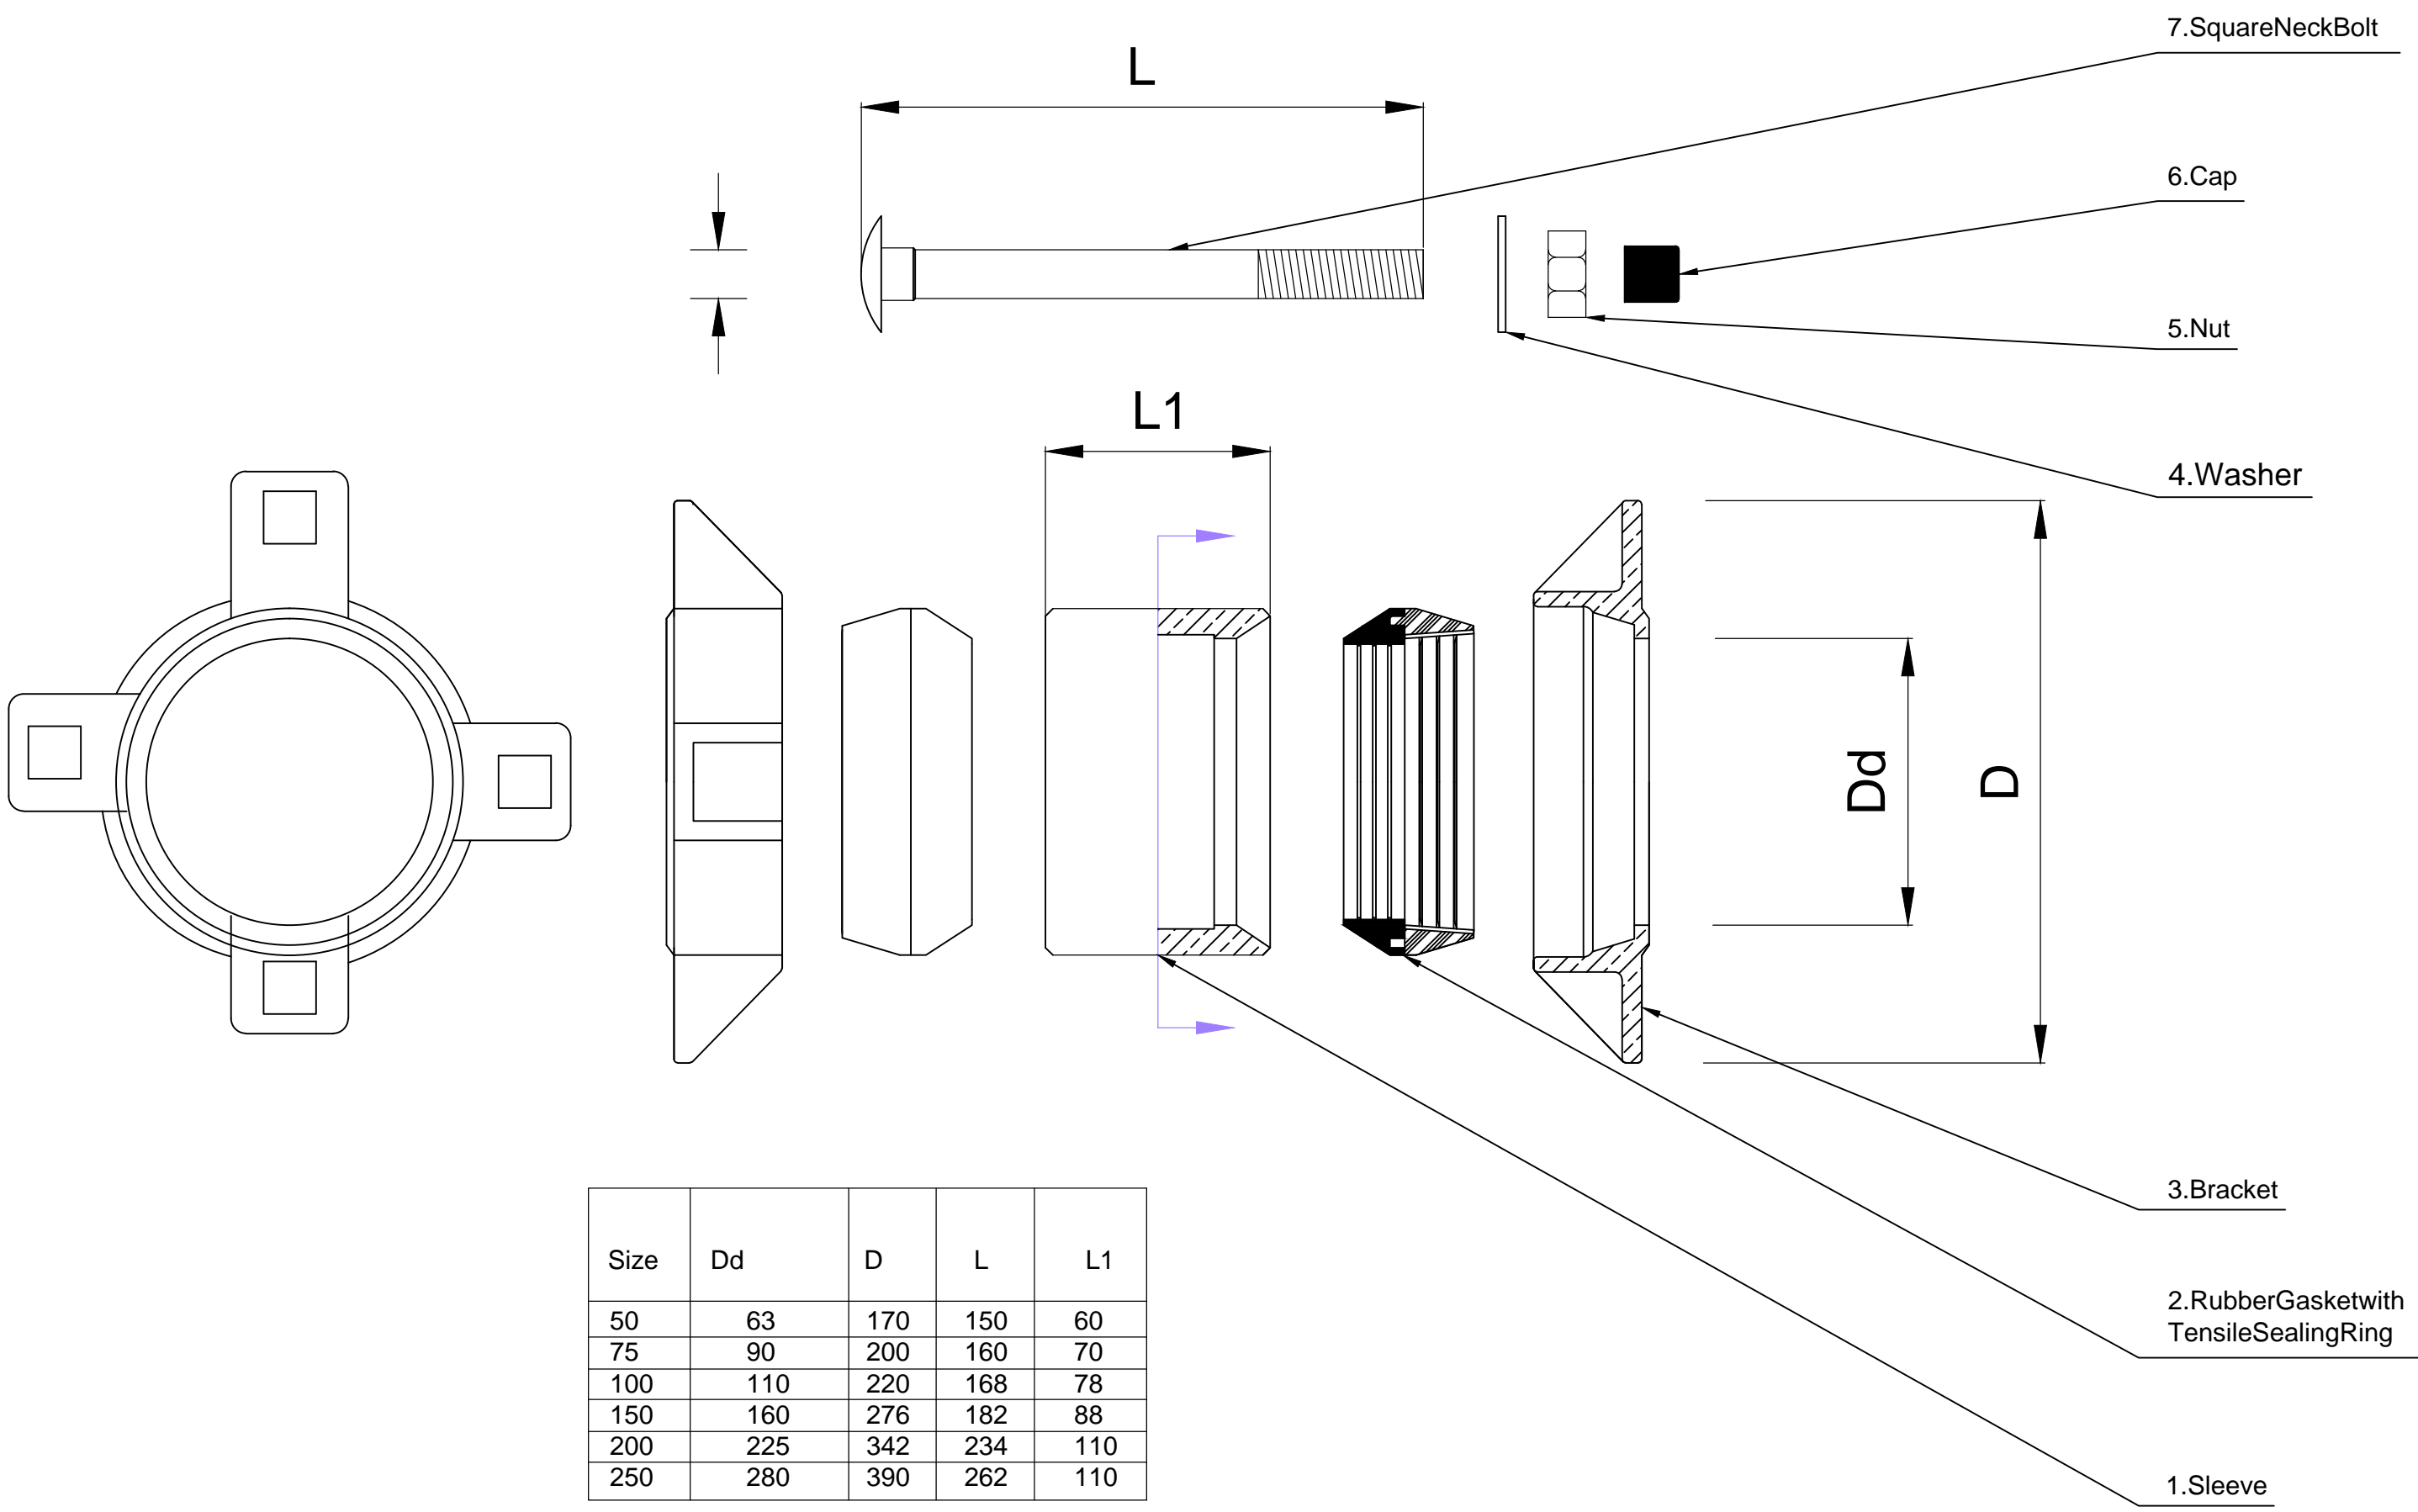

STANDARD SHOP DRAWING

D.I. SLEEVE TYPE COUPLING with TENSILERING

STA. MARIA WATER DISTRICT

Prepared By: Engr. Emmanuel Enrico A. de Vera
Department Manager B

Approved By: Engr. Carlos N. Santos, Jr.
General Manager

SHEET NO.

6